

Job Name \_\_\_\_\_  
 Purchaser \_\_\_\_\_  
 Submitted to \_\_\_\_\_  
 Unit Designation \_\_\_\_\_

Location \_\_\_\_\_  
 Engineer \_\_\_\_\_  
 Reference \_\_\_\_\_ Approval \_\_\_\_\_ Construction \_\_\_\_\_  
 Schedule # \_\_\_\_\_

**Specifications**

Model	Indoor Unit Model Number	AC012KNLDCH/AA		
	Outdoor Unit Model Number	AC012KXADCH/AA		
Performance	Nominal Capacity*	Cooling / Heating (Btu/h)	12,000 / 14,000	
	Capacity Range*	Cooling (Btu/h)	3,400 - 15,300	
		Heating (Btu/h)	3,000 - 16,200	
	SEER / EER		20 / 12	
	COP (nominal heating)		3.16	
	HSPF		10.5	
	AHRI Certification Number		8715730	
Condensate (pints/hour)		3.38		
Power	Voltage	ø / V / Hz	1 / 208-230 / 60	
	Working Voltage Range (VAC)		176 - 254 (max. 3% deviation from each)	
	Operating Current (min. / std. / max.)	Cooling (A)		1.6 / 4.7 / 7.1
		Heating (A)		1.4 / 6.0 / 6.8
	Max. Breaker	Amps		15
Min. Circuit Ampacity (A)			10.6	
Dimensions	W X H X D (inches)	Indoor Unit	27 9/16 X 7 13/16 X 23 5/8	
		Outdoor Unit	31 1/8 X 21 9/16 X 11 1/4	
	Weight (lbs.)	Indoor Unit	44.0	
		Outdoor Unit	79.8	
	Duct Connections (inches)	Supply (W X H)	26 X 6	
	Return (W X H, ID)	22 11/16 X 6 11/16		
Heat Exchanger	Indoor and Outdoor Unit	Type	Aluminum Fin / Copper Tube	
		Pipe Diameter (inches)	1/4	
Sound Pressure Level	Indoor Unit dB(A)	L / M / H	27 / 31 / 34	
	Outdoor Unit dB(A)	Cooling / Heating (high)	47 / 48	
Operating Temperatures (°F)	Outdoor	Cooling	23 ≤ T ≤ 115	
		Heating	0 ≤ T ≤ 115 W/Baffle	
	Indoor	Cooling	-4 ≤ T ≤ 76	
		Heating	61 ≤ T ≤ 90	
Pipe Connections	Indoor & Outdoor	High side X low side (flare)	1/4 X 3/8	
	Maximum Length	Feet	65.6	
	Maximum Vertical Separation (ft.)		49	
	Condensate Connection		1" OD, 3/4" ID	
Refrigerant	Type		R410A	
	Control Method		Electronic Expansion Valve	
	Factory Charge	oz.	37.04	
	Charged for		25 feet	
Additional Refrigerant		0.11 oz./ft. over 25 feet		
Compressor	Type		Inverter Driven, BLDC Rotary	
	RLA	A	8.1	
Evaporator Fan	Type		BLDC (1) With Sirocco Fan (2)	
	Air Volume	CFM (L / M / H)	318 / 370 / 425	
	Output	Watts	69	
	FLA	A	0.31	
	Static Pressure	Standard ("WC)	0.1	
	Min. / Max. ("WC)	0 / .24		
Condenser Fan	Motor		BLDC With Axial Type Fan (1)	
	FLA / Watts / Max. CFM		0.17 / 39W / 1,271 CFM	
Optional Accessories	Filter Box		FB-SLIM1	
			MWR-SH00N	
	Wired Controller	Simplified		MWR-SH10N
		Simplified Touch Controller		MWR-SH10N
		Premium W/Scheduling		MWR-SH10N
	Wireless Signal Control	Wireless Signal Receiver		MRK-A00N
		Wireless Controller		MR-EH00U
	Wi-Fi Adapter		MIM-H03UN	
	External Temperature Sensor		MRW-TA	
	External Contact Control		MIM-B14	
	Central Control Interface Module for Connection to DVM Plus Controls (non-NASA)		MIM-N01	
	Wall Bracket (for outdoor unit)			CKN-250
Front			WBMF-9/12/18	
Wind Baffles	Back		WBMB-9/12/18/36	
Line Sets - insulated and flared, interconnect cables included			25' - ILS2506	
			50' - ILS5006	
Safety	Certifications	ETL, ETLc		
	Devices	PCB fuses, indoor unit terminal block thermal fuse, current transformer, over-voltage protection, crankcase heating, temperature limit protection logic, compressor overload sensing		



- Horizontal discharge airflow
- The indoor unit shall have a built-in condensate pump as standard with a 29" lift (from bottom of unit).
- Low ambient control built in
- The outdoor unit shall supply power to indoor unit via 14 AWG X 3 power wire
- Auto-restart after power loss
- The outdoor unit shall have a snow accumulation prevention option setting to prevent snow drifting against an idle outdoor unit.
- The indoor and outdoor units shall have a removable EEPROM that stores system programming information, unit name, and other data
- All indoor unit option settings shall be done digitally; the indoor unit does not contain rotary dials or setting switches.
- The outdoor unit shall have a night time quiet mode option to reduce operating sound during the night.
- Electrostatic, washable filter included as standard.

**Construction**  
 The outdoor unit shall be galvanized steel with a baked on powder coated finish for durability

The indoor unit shall be insulated, galvanized steel.

**Heat Exchanger**  
 The indoor and outdoor unit heat exchanger shall be mechanically bonded aluminum fin to copper tube

**Controls**  
 Control signal shall be a DDC type signal

Interconnect control wire between outdoor indoor unit shall be 16AWG X 2 shielded

Wired or wireless controls must be purchased separately

Connection to optional wired controllers shall be 2 X 16AWG shielded wire

Controls shall integrate with a BMS system

The system shall integrate with the Samsung NASA Controls Solution

No additional interface modules/adapters are required when connecting to Samsung NASA DVM S central control options (MIM-D00AN, MIM-B17N, MIM-B18N, MCM-A300N).

**Refrigerant System**  
 The refrigerant shall be R410A

The compressor shall be hermetically sealed, inverter controlled, BLDC Rotary

Refrigerant flow shall be controlled by an electronic expansion valve at outdoor unit


Soft-start to reduce current demand during compressor start

**Warranty**  
 10 Years compressor, 10 years parts, 1 year limited labor when registered


**ATTENTION**  
 This air handling unit is intended for free-air discharge or for connection to a duct supplying only one room. Improper installation could contribute to the spread of smoke or flame in the event of a fire.

\* Nominal cooling capacities are based on: Indoor temperature: 80°F DB, 67°F WB. Outdoor temperature: 95°F DB, 75°F WB.  
 \* Nominal heating capacities are based on: Indoor temperature: 70°F DB, 60°F WB. Outdoor temperature: 47°F DB, 43°F WB.


Quietside maintains a policy of ongoing development, specifications are subject to change without notice. Refer to www.AHRIdirectory.org for current reference numbers.

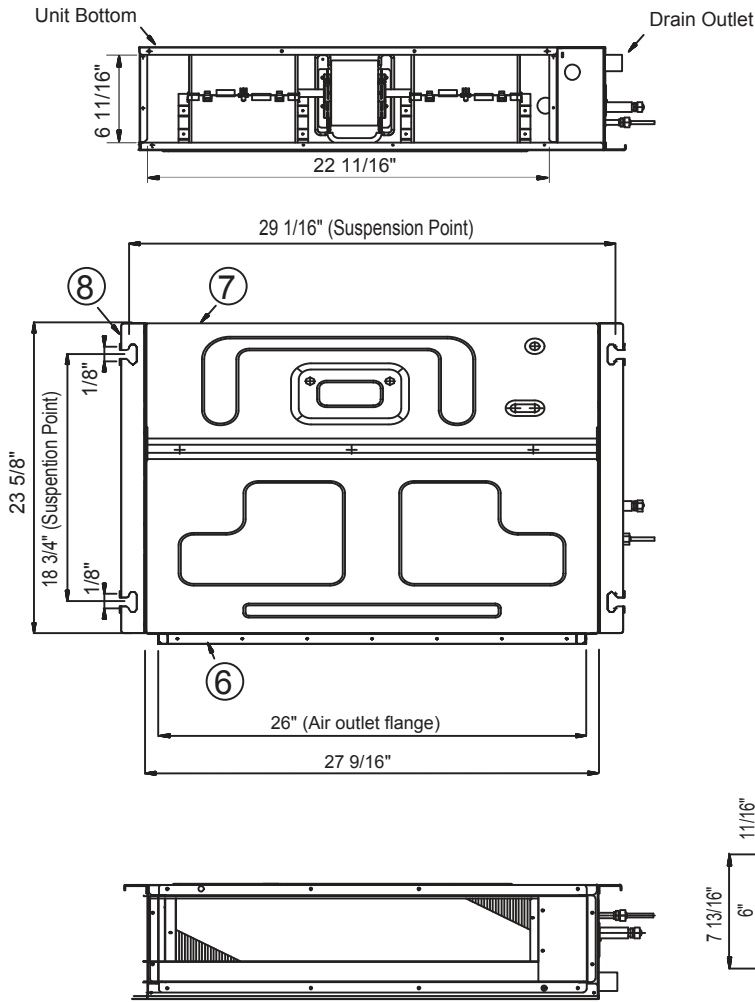


No.	Name	Description
①	Liquid Pipe Connection	Ø 1/4" Flare
②	Gas Pipe Connection	Ø 3/8" Flare
③	Drain Pipe Connection (gravity drain)	OD 1", ID 3/4"
④	Drain Pipe Connection (condensate pump)	OD 1", ID 3/4"
⑤	Control Box	-
⑥	Air Discharge Flange	-
⑦	Air Inlet	-
⑧	Suspension Hook	5/16" - 3/8"

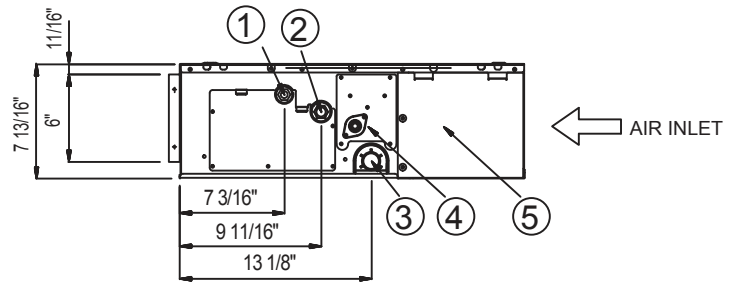

Unit Clearance From Structure

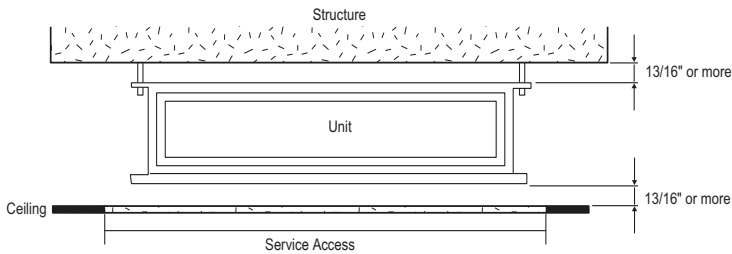








Inspection Opening Requirements

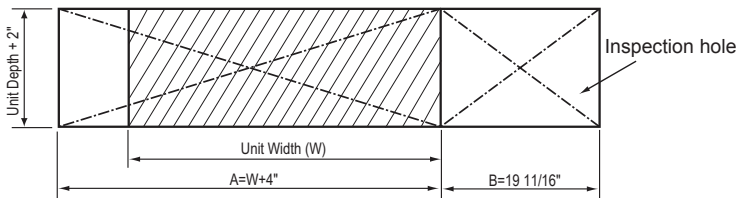

In applications where there is not a tile ceiling, an inspection hole is required.  
 If height between ceiling and structure is 3.25' or more, inspection opening "B" is recommended.  
 If height between ceiling and structure is less than 3.25', inspection opening "A" and "B" is recommended (verify state and local codes).

P-Q Curve

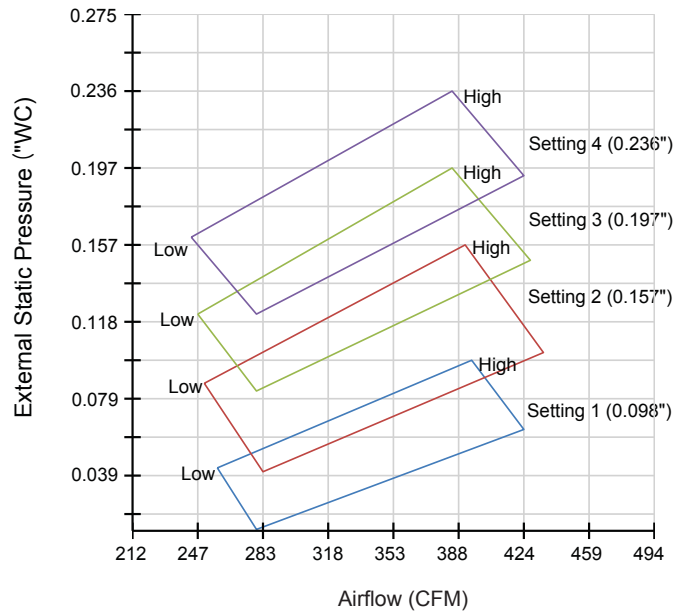

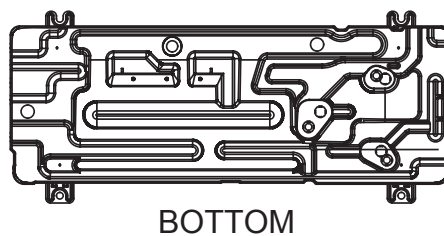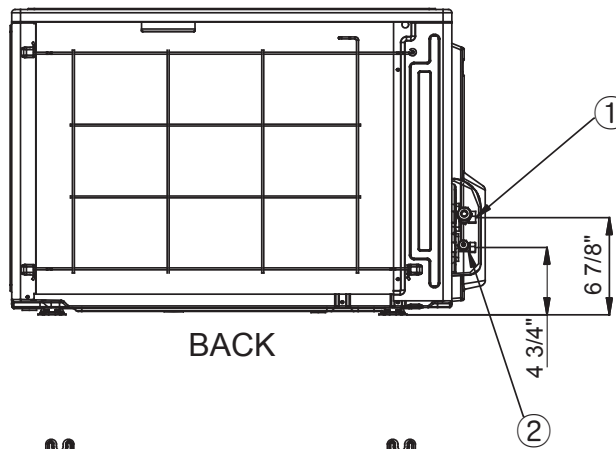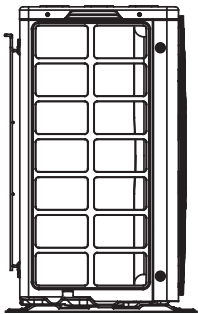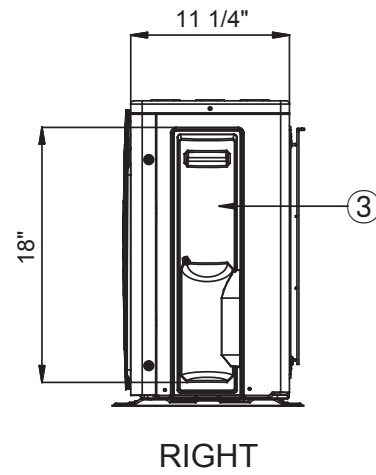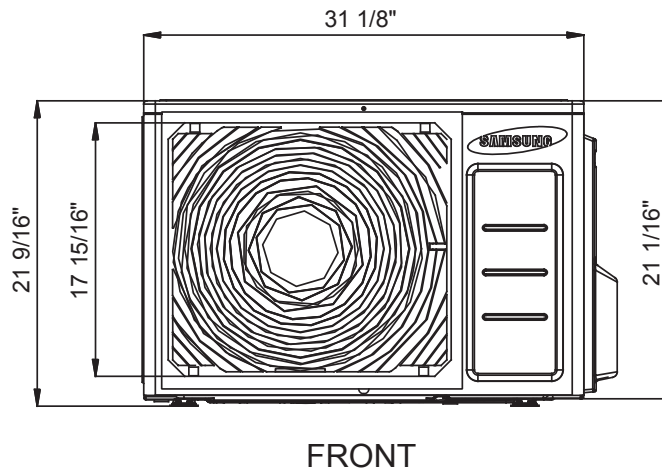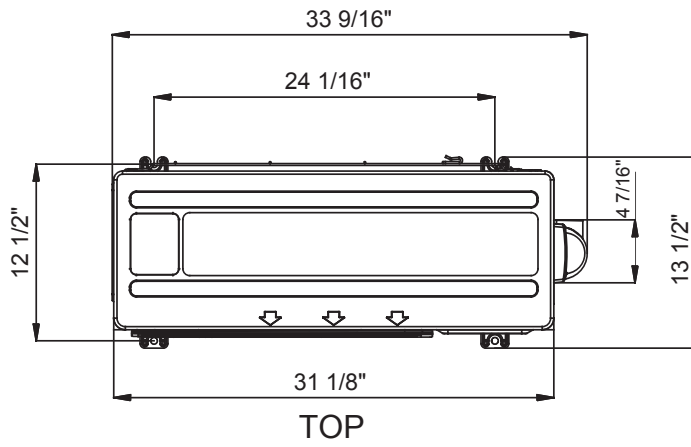

No.	Name	Description
①	Gas Pipe Connection	Ø 1/4" Flare
②	Liquid Pipe Connection	Ø 3/8" Flare
③	Power and Comm. Wire Connection Cover	-