# Quest DRY70

# Installation, Operation and Maintenance Instructions

# - Read and Save These Instructions -

This manual is provided to acquaint you with the dehumidifier so that installation, operation and maintenance can proceed successfully. Ultimate satisfaction depends on the quality of installation and a thorough understanding of this equipment. The dehumidifier is built around tested engineering principles and has passed thorough internal and 3rd party inspections for quality of workmanship and function.

# Quest *DRY* 70 FEATURES:

- Energy Star Listed
- Large Capacity
- MERV-11 Filtration
- Low Temperature Operation
- Carbon Filtration
- Optional Equipment
  - Ducting Kit
  - Hang Kit
  - Caster Kit
  - Condensate Pump



Water Removal Rate (Pints/Day)

65 pints 80°F, 60% (AHAM)



4201 Lien Rd. Madison, WI 53704 www.QuestProtect.com

1-800-533-7533 sales@QuestProtect.com



# Quest DRY 70

# **Installation, Operation and Maintenance Instructions**

#### **Table of Contents**

Introduction1
Features & Benefits
Safety Precautions
1. Intended Application4
2. Registrations4
3. Specifications4
4 . Installation
4.1 Installation Checklist4
4.1A Power Accessibility5
4.1B Space5
4.1C Low Voltage Wiring5
4.1D Back-Draft Damper5
4.1E Support Structure and Suspension5
4.2 Electrical Requirements5
4.3 Condensate Removal6
4.3A Lifting Condensate6
4.3B Condensate Pump Kit6
4.4 Ducting6
4.4A Fresh Air/Supply Air7
4.4B Ducting for Fresh Air - Option7
4.4C Installation in a Basement or Crawlspace . 8
4.4D Installation in an Attic8
4.4E Installation in a Structure with
No Forced Air HVAC System9
4.4F Ducting for High Efficiency Filtration9
4.5 Compressor Release and Noise Abatement9
4.6 Controls
5. Control Package Diagram Sheet11
6. Maintenance
6.1 High Efficiency Air Filter12
6.2 Optional Fresh Air Intake12

7. Wiring Diagrams 13
8. Optional Parts List12
9. Service Parts List14
Routine Maintenance14
10. Service15
10.1 Technical Description15
10.2 Troubleshooting15
10.3 Refrigerant Charging16
10.4 Compressor/Capacitor Replacement 17
10.5 Electric Ventilation Damper17
Warranty18



#### FOR HVAC INSTALLER AND OWNER

## **Safety Precautions**

Read the installation, operation and maintenance instructions carefully before installing and operating this device. Proper adherence to these instructions is essential to obtain maximum benefit from your Quest *DRY* 70.

#### READ AND SAVE THESE INSTRUCTIONS

- The device is designed to be installed INDOORS IN A SPACE THAT IS PROTECTED FROM RAIN AND FLOODING.
- Install the unit with space to access the front panel for maintenance and service. DO NOT INSTALL UNIT WITH THE FRONT PANEL INACCESSIBLE.
- Avoid directing the discharge air at people, or over the water in pool areas
- If used near a water source; be certain there is no chance the unit could fall into the water or get wet. The unit should also be plugged into a GFCI (Ground Fault Circuit Interrupt) outlet.
- **DO NOT** use the device as a bench or table.
- **DO NOT** place the device directly on structural members.
- A drain pan MUST be placed under the unit if installed above a living area or above an area where water leakage could cause damage (see local regularity code for more information).
- Never operate a unit with a damaged power cord. If the power cord is damaged it must be replaced by the manufacturer, its service agent, or similarly qualified person in order to avoid a hazard.
- The unit shall be installed in accordance with national wiring regulations.
- Do not obstruct the air intake and exhaust. Maintain a .3 m (1 ft) clearance around the air intake and exhaust.
- This appliance is not intended for use by persons (including children)
  with reduced physical, sensory or mental capabilities, or lack of
  experience and knowledge, unless they have been given supervision or
  instruction concerning use of the appliance by a person responsible for
  their safety. Children should be supervised to ensure that they do not
  play with the appliance.



#### FOR HVAC INSTALLER ONLY

## 1. Intended Application for Quest Dry 70

For the ideal installation, draw air from the central part of the workspace and return it to isolated areas of the structure. The ductwork of the existing heating system can be used to supply air to the workspace.

#### 2. Registrations

The Quest Dry 70 conforms to unified standard UL 60335-2-40.

## 3. Specifications

Part Number: 4033750

Blower: 150 CFM @ 0.0" WG

Power: 680 Watts @ 80°F and 60% RH Supply Voltage: 110-120 VAC – 1phase – 60 Hz

Current Draw: 5.1 Amps
Energy Factor: 2.37 l/kw
Operating Temp.: 33°F to 100°F

Sized for: 1800 Sq. Ft. - Workspace (Max)

#### Miniumum Performance at 80°F and 60% RH

Water Removal: 65 pints/day Efficiency: 4.5 Pints/kWh

Air Filter: MERV-11

Efficiency: Standard 70% Efficient

**ASHRAE Dust Spot Test** 

Size: 12" x 12" x 1"

Power Cord: 8', 110-120 VAC, Grounded

Drain Connection: 3/4" Threaded MPT

Drain Hose: 5/8" ID x 81

#### **Dimensions**

	Unit	Shipping
Width:	12"	15 5/8"
Height:	12"	16"
Depth:	28"	31 5/8"
Weight:	55 lbs	65 lbs

#### 4. Installation

#### 4.1 Installation Checklist



Prior to installation of the Quest Dry 70, please review the following requirements. The Quest Dry 70 can be installed in a variety of locations to meet the owner's needs, and be integrated with existing forced air systems or existing ductwork if desired. The location choice is contingent on a variety of requirements not limited to: ease of service, controls access, drainage, filtration, power, fresh-air ventilation (optional), water damage prevention, and current regulatory codes (ASHRAE, fire, etc). Please address all of these issues before you select the location of the device.



#### FOR HVAC INSTALLER ONLY

#### 4.1A Power Accessibility

Unit should be located in an area where the cord's length (8') should easily reach a 110-120 VAC electrical outlet with a minimum of a 15 A circuit capacity.

#### 4.1B Space

Location should have enough clearance to handle the unit's overall dimensions as well as the necessary return/supply ductwork to the unit.

#### 4.1C Low Voltage Wiring

Unit location should be in an area where field wiring the remote controls (low voltage) to the unit will be possible.

#### 4.1D Back-Draft Damper (P/N 4023647)

It is recommended that a back-draft damper be used in the discharge duct of the Quest Dry 70, especially when connecting to the supply ducting system. The back-draft damper prevents supply air from counter flowing through the Quest Dry 70 when it is not operating. The unit location should be chosen to allow installation of this accessory.

#### 4.1E Support Structure and Suspension

Place the Quest Dry 70 on supports to raise the base of the unit. Do not place the Quest Dry 70 directly on structural building members without vibration absorbers or unwanted noise may result.

The Quest Dry 70 may be suspended with a hang kit (4028111) or a suitable alternative from structural members, as long as the suspending assembly supports the Quest Dry 70's base in its entirety. Do not hang the Quest Dry 70 from the cabinet. Remember to place a drain pan under the unit if it is suspended above a finished area or above an area where water leakage could cause damage.



#### 4.2 Electrical Requirements

# **⚠ WARNING!**

WARNING: DO NOT ALLOW THE YELLOW LEAD FROM THE Quest TO CONTACT THE RED LEAD FROM THE Quest OR DAMAGE TO THE TRANSFORMER WILL RESULT.

Hang Kit (4029908) shown suspending a Quest Dry 70. Available from your dealer or call 1-800-533-7533.

The Quest Dry 70 plugs into a common grounded 115VAC outlet. The device draws 5.1 Amps under normal operating conditions. If used in an area which may become wet, a GFCI (Ground Fault Interrupt) outlet is required. Please, consult local electrical codes for any further information.

Therma-Stor LLC offers a family of control devices for use with the Quest Dry 70. The controls are to be located remotely from the unit and located in the space to be conditioned. The controls are low voltage (24 volt) and should be connected to the Quest Dry 70 with low voltage wire (thermostat or other appropriate).



Do not install the control panel where it may not accurately sense the relative humidity such as near HVAC supply registers, near exterior doors, on an outside wall, near a window, or near a water source.



Quest DEH 3000 Digital Control (P/N 4027370) Call 1-800-533-7533



#### FOR HVAC INSTALLER ONLY

The installer must supply the wiring between the Quest Dry 70 and the control panel. Be sure to safely route the control wiring to prevent damage during installation.



# **CAUTION**

Do not cross wires when connecting the Quest Dry 70 and the remote control panel or damage to the transformer may result. The remote controls of the Quest Dry 70 are powered by a low voltage circuit (24VAC) and must NEVER contact or be connected to a high voltage circuit.

The control wires leaving the Quest Dry 70 and the remote control panels are numbered and color-coded to prevent confusion. Some of the control wires leaving the Quest Dry 70 may not be used with certain control panels and should be left unconnected with wire nuts taped onto the stripped ends for safety. Be sure to consult the electrical schematic in this manual or inside the access panel of the Quest Dry 70 before making control connections.

#### 4.3 Condensate (Water) Removal



## **CAUTION**

A trap in the drain line is preferred, but not required for the unit to drain properly. Local codes may require a trap. Use care to keep the pipe assembly as flat to the floor as possible. Kinks and/or humps will prevent proper drainage.


The Quest Dry 70 generates condensate. Install a 3/4" male nominal pipe thread adapter to the drain pan. It is necessary to assemble your own drain pipe assembly utilizing 3/4" PVC pipe to get the condensate to a floor or other drain. Pipe is commonly available in 10' lengths from building supply, plumbing or hardware stores. Slope to drain should be at least 1" drop for every 10' of run.

#### 4.3A Lifting Condensate

A condensate pump may installed if lift is required to dispose of the condensate.

#### 4.3B Condensate Pump Kit (4030113)

A condensate pump kit is available from the factory for use with the Quest Dry 70 and provides 15' of lift. Condensate is automatically pumped to a remote location when the water level in the pump's reservoir rises to close the float switch. The pump also contains a safety float switch. The white leads from this switch extend from beneath the pump cover. This switch should be installed in series with the field wire that connects the blue (#5) lead from the Quest Dry 70 to the the control panel. If the pump fails, this switch opens the compressor control circuit and stops water production before the reservoir overflows. The Quest Dry 70 will continue to ventilate or circulate air as normal, but will not dehumidify until this switch closes.



Condensate Pump Kit (4030113) shown installed. Available from your dealer or call 1-800-533-7533.

#### 4.4 Converting to Vertical Discharge Airflow

The QuestDry 70 is shipped from the factory with the exhaust panel of the cabinet configured for horizontal air discharge. The cabinet can be easily converted to vertical air discharge. To convert the air discharge from horizontal to vertical, follow these steps:



1. Using T-20 Torx Driver, remove three (3) sheet metal screws that attach the exhaust panel from each side of the Quest Dry 70. There will be a total of six (6) screws. Do not remove the exhaust collar.



2. Remove the exhaust panel.



3. Rotate the exhaust panel so that the exhaust collar is located on the top of the unit. Align screw holes and snap the panel onto the base.



4. Secure the exhaust panel to the base by replacing the six (6) screws.



For the ideal installation, draw air from the central part of the workspace and return it to the isolated areas of the workspace like the bedrooms, den, utility room, or family room. The ductwork of the existing heating system can be used to supply air to the workspace. If the existing supply goes to isolated areas of the structure, discharge the supply of the Quest Dry 70 into the supply of the existing heating system. Installation of a separate supply duct to the Quest Dry 70 from a central area is recommended.



#### 4.4A Supply Air



DO NOT draw air directly from the kitchen, laundry, or isolated basement.

You may draw air from a basement that is open to the workspace. All flexible ducting connected to the Quest Dry 70 should be UL listed.

A short piece of flexible ducting on all Quest Dry 70 duct connections is recommended to reduce noise and vibration transmitted to rigid ductwork in the structure. Ducting the Quest Dry 70 as mentioned requires consideration of the following points:

**Duct Sizing:** For total duct lengths up to 25', use a minimum 8" diameter round or equivalent rectangular. For longer lengths, use a minimum 10" diameter or equivalent. Grills or diffusers on the duct ends must not excessively restrict airflow.

**Connecting to existing HVAC systems:** An optional 8" check backdraft damper is available from the factory to prevent reverse air flow through the Quest Dry 70. If the Quest Dry 70 is ducted to the supply of an air handler, the check damper should be placed in the Quest Dry 70 supply duct.

# **A** CAUTION

Contact the factory when connecting to a static pressure of greater than or equal to +.5" WG.

#### 4.4B Ducting for Fresh Air — Option

Fresh air may be brought into the structure by connecting an insulated duct from outside the structure to the 6" inlet of the Quest Dry 70. Advantages of this form of ventilation include:

- 1. Outside air is filtered before entering the building.
- 2. Outside air will be dehumidified before entering the building if the Quest Dry 70 is running in dehumidification mode.
- 3. Drawing air from outside and blowing inside aids in slightly pressurizing the structure. This helps prevent dirty and humid air from entering elsewhere. It also reduces the potential for carcinogenic radon gas to enter and provides a small amount of make-up air for open combustion and exhaust devices like the clothes drier, fireplace, and water heater.
- 4. Exhaust fans are recommended in the bath rooms and kitchen.

In cold climates or areas where the outdoor dew point is low at times, ventilation can be used to dehumidify the structure, making the Quest Dry 70 capable of year-round drying. This is accomplished by bringing the dry, low dew point air into the structure during these times. This approach is often more economical than running the dehumidifier to remove excess moisture from the structure. In cold climates, adequately ventilating is critical to reduce the inside moisture content and avoid moisture accumulating in the wall cavities. TIP: If your structure experiences condensation on the interior surface of the windows during the winter, increasing the amount of ventilation will often solve the problem.


An insulated 6" diameter duct is generally sufficient to provide up to 70 CFM of outside air. Large quantities of outside air will impact Quest Dry 70 performance positively or negatively, depending upon the inside and outside air conditions. The outside air duct should be connected to the front of the unit. With a standard tee, the amount of outside air can be restricted with a blade damper.



#### 4.4C Installation in a Basement or Crawlspace with an Existing Forced Air HVAC System.

**Basement Installation:** Install a separate 8" return for the Quest Dry 70 in a central area of the structure. Optional: Duct the supply of the Quest to a 8" x 8" x 8" tee/damper, adjusted to 20% open to the basement. Duct the other side of the tee to the air supply of the existing HVAC system with a backdraft damper.

**Crawlspace Installation:** Install a separate return for the Quest Dry 70 in a central area of the structure. Optional: Duct the supply of the Quest Dry 70 to a 8" x 8" x 8" tee/damper that is 20% open to the crawlspace if desired. Duct the other side of the tee to the air supply of the existing HVAC system with a backdraft damper.

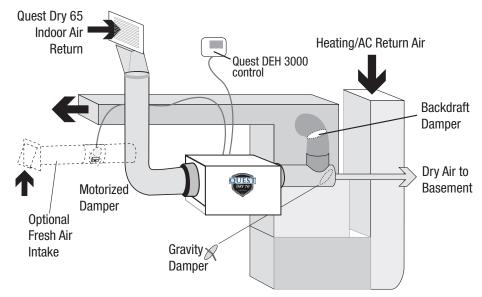

Instead of installing a separate return to the Quest Dry 70, and if the existing system has multiple returns, it is possible to select one to disconnect from the existing forced air system and use it for the dedicated Quest return. Always select a return from a central location in the structure in an area that is always open to the rest of the structure. Do not use a return from a room that may have its door closed much of the time or, alternatively, install a separate return from the open part of the structure.


#### 4.4D Installation in an Attic with an Existing Forced Air HVAC System

# **A** CAUTION

ALWAYS place a drain pan under the unit if it is suspended above a finished area or above an area where water leakage could cause damage.



#### FOR HVAC INSTALLER AND OWNER

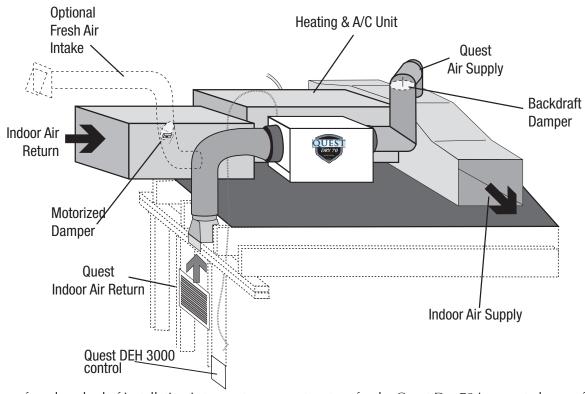

The preferred method of installation is to create a separate return for the Quest Dry 70 in a central area of the structure. Duct the supply of the Quest Dry 70 to the air supply of the existing HVAC system.

#### 4.4E Installation in a Structure with No Existing Forced Air HVAC System

When installing the Quest Dry 70 in a structure that does not have a forced air HVAC system, a single return for the Quest Dry 70 should be installed in central open area of the structure. DO NOT locate the return in a bathroom or a kitchen. The supplies of the Quest Dry 70 should be located in the remote areas of the structure. By ducting this way, the air inside the structure will circulate through the Quest Dry 70 to be filtered and dehumidified. A 6" diameter duct is recommended for branches to the remote rooms. A 8" diameter duct is recommended for branches to larger areas.

#### 4.4F Ducting for High Efficiency Filtration

The Quest Dry 70 is equipped with a high efficiency MERV 11 media filter (P/N 4027158). For optimal performance it is recommended that the filter be replaced every 3-6 months.

#### 4.5 Noise Abatement

A length of 10 feet or more of flex ducting on the outlet of the Quest Dry 70 will reduce air noise from the fan. A length of flexible ducting on all Quest Dry 70 duct connections is recommended to reduce noise transmitted to rigid ductwork in the structure.



#### 4.6 Controls

The Quest Dry 70 features a built-in dehumidistat control as well as the ability to wire a remote mounted control to the unit. The control used to operate the unit should be located in an area where the control can accurately sense the humidity of the area where humidity control is desired.

If the Quest Dry 70 is located in the area where humidity control is desired, consider using the built-in control. Adjust the humidity control so that the unit maintains the desired level of humidity.

If the Quest Dry 70 is located outside of the area where humidity control is desired, consider using a remote wired humidity controller that is located in the area where humidity control is desired.

When using a remote wired dehumidistat, be sure the built-in dehumidistat is set to the off position by turning it counterclokwise until it stops. Failure to do so may cause the unit to sense the humidity from the wrong area.

**WARNING: DO NOT** allow the yellow lead from the unit to contact the red lead or the white lead from the unit or damage to the transformers will result.



Control Part No. 4027370

The Quest dehumidifier is controlled using five color-coded wires.

Green (or brown) = Fan control

Blue = Dehumidification (fan and compressor) control

Red = 24volt AC power transformer neutral side (common with white)

White = 24volt AC power transformer neutral side (common with red)

Yellow = transformer high side

Between the red/white lead and the yellow leads is a 40VA transformer. This low voltage power source powers the relay coils which control the fan and compressors. This 24VAC transformer can also be used to power HVAC assessories external to the dehumidifier.

- To turn the dehumidifier on make contact between yellow and blue wires.
- To turn the fan on make contact between yellow and green(or brown) wires.
- To power an HVAC accessory, connect the accessory to the white (or red) wire and the yellow wire.



#### FOR HVAC INSTALLER AND OWNER

**5 Control Package Diagram** 


# **WARNING:** Allowing yellow wire to contact red or white wire will **destroy** the transformer.

Dehumidifier on: Connect yellow and blue wires.

Fan only on: Connect yellow and green (or brown) wires.

Accessory power: 24volt AC power supply available for HVAC accessories between yellow and white(and/or red) wire. Red and white wires are common with each other.

#### Quest DEH 3000 dehumidification & ventilation control

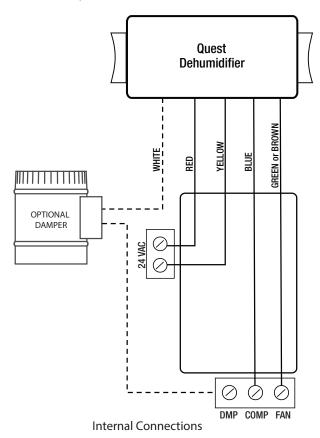



#### 6. Maintenance

#### **6.1 High Efficiency Air Filter**

The Quest Dry 70 is equipped with a MERV 11 media filter. This filter should be checked every three months. Operating the unit with a dirty filter will reduce dehumidifier capacity and efficiency and may cause the compressor to cycle off and on unnecessarily on the defrost control.

DO NOT operate the unit without a filter or with a less effective filter. Operating the unit without a filter or with a less effective filter may cause internal damage to the unit and invalidate the product warranty.

#### **6.2 Optional Fresh Air Intake**

Check and clean the screen on the outdoor fresh air intake port seasonally. The screen may become plugged during the seasons when there are many particles in the outdoor air.

To replace the filter, remove the filter door from one of the sides of the Ultra-Aire 70H by pushing the snap button in and gently pulling to door away from the body of the unit, then pulling up to disengage the door flange from the slot, removing the door.




Remove the filter by gently pulling straight out of the unit. Insert new filter in the same manner, pushing it gently straight into the unit.



Replace filter door by inserting the bottom tab into the slot, aligning the door and pushing it gently against the unit until the snap button secures the door.



# 7. Wiring Diagram

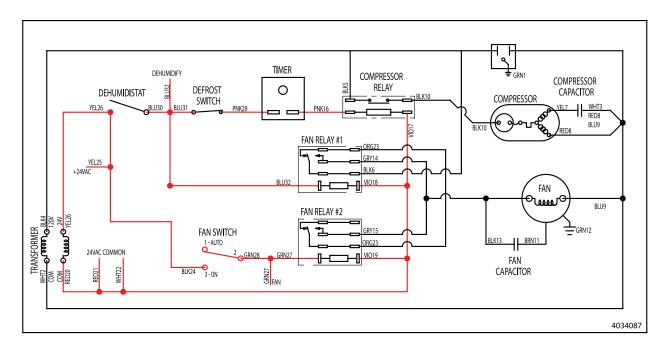



# 8. Optional Parts List: Quest Dry 70

Part No.	Description
4030671	Filter MERV 11
4030113	Pump Kit
4029908	Hang Kit
4023647	8" Gravity Damper
4020646	8" Butterfly Damper
4027415	8" Flex Duct
4020177	8" Flex Duct (insulated)
4027430	Register Head 8"
4020126	Register Grill (White)

# 9. Service Parts List: Quest Dry 70

Description
Compressor
Compressor Overload
Compressor Relay
Capacitor 35 MFD
Capacitor 6 MFD
Coil Set
Impeller Fan
Fan Relay
Control, Humidity
Defrost Thermostat
Timer Relay
Leveling Feet
Transformer

#### **FOR OWNER - ROUTINE MAINTENANCE**

Part No.	Description	
4030671	Air Filter MERV 11	
4030734	4Pack	
4030733	12Pack	

The Quest Dry 70 is equipped with a MERV 11 media filter. This filter should be checked every three months. Operating the unit with a dirty filter will reduce dehumidifier capacity and efficiency and may cause the compressor to cycle off and on unnecessarily on the defrost control.



#### 10. Service

# **A** CAUTION


CAUTION: Servicing the Quest Dry 70 with its high pressure refrigerant system and high voltage circuitry presents a health hazard which could result in death, serious bodily injury, and/or property damage. Please contact your HVAC professional.

#### **10.1 Technical Description**

The Quest Dry 70 uses a refrigeration system similar to an air conditioner's to remove heat and moisture from incoming air, and add heat to the air that is discharged. Hot, high-pressure refrigerant gas is routed from the compressor to the condenser coil (See Figure 1). The refrigerant is cooled and condensed by giving up its heat to the air that is about to be discharged from the unit. The refrigerant liquid then passes through a strainer and capillary tubing which causes the refrigerant pressure and temperature to drop. It next enters the evaporator coil where it absorbs heat from the incoming air and evaporates. The evaporator operates

in a flooded condition, which means that all the evaporator tubes contain liquid refrigerant during normal operation. A flooded evaporator should maintain nearly constant pressure and temperature across the entire coil, from inlet to outlet.

The mixture of gas and liquid refrigerant enter the accumulator after leaving the evaporator coil. The accumulator prevents any liquid refrigerant from reaching the compressor. The compressor evacuates the cool refrigerant gas from the accumulator and compresses it to a high pressure and temperature.

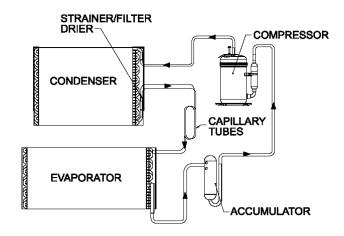

Refrigeration System of Quest Dry 70

#### 10.2 Troubleshooting

#### Neither fan nor compressor running. Dehumidification is being called for. No fan call.

- 1. Unit unplugged or no power to outlet.
- 2. Humidity control set too high.
- 3. Loose connection in internal or control wiring.
- 4. Defective Compressor relay.
- 5. Defective control transformer.

#### Compressor is not running. Dehumidification is being called for. No fan call.

- 1. Defective compressor run capacitor.
- 2. Loose connection in compressor circuit.
- 3. Defective compressor overload.
- 4. Defective compressor.
- 5. Defrost thermostat open.

#### Compressor cycles on and off. Dehumidification is being called for. No fan call

- 1. Low ambient temperature and/or humidity causing unit to cycle through defrost mode.
- 2. Defective compressor overload (Sec. 7.6A).
- 3. Defective compressor (Sec. 7.6).
- 4. Defrost thermostat defective (Sec. 7.8).
- 5. Dirty air filter(s) or air flow restricted.



#### Quest DRY 70

## **Installation, Operation and Maintenance Instructions**

#### FOR HVAC INSTALLER ONLY

#### Fan is not running. Dehumidification or fan is being called for

- 1. Loose connection in fan circuit.
- 2. Obstruction prevents fan impeller rotation.
- 3. Defective fan.
- 4. Defective fan relay.

#### Low dehumidification capacity (evaporator is frosted continuously). Dehumidification is being called for

- 1. Defrost thermostat defective.
- 2. Low refrigerant charge
- 3. Dirty air filter(s) or air flow restricted.
- 4. Excessively restrictive ducting connected to unit.

#### No ventilation. Ventilation is being called for.

- 1. Loose connection in ventilation control circuit
- 2. Loose connection in damper power circuit.
- 3. Defective fresh air damper.

#### Unit removes some water, but not as much as expected.

- 1. Air temperature and/or humidity have dropped.
- 2. Humidity meter and or thermometer used are out of calibration.
- 3. Unit has entered defrost cycle.
- 4. Air filter dirty.
- 5. Defective defrost thermostat.
- 6. Low refrigerant charge.
- 7. Air leak such as loose cover or ducting leaks.
- 8. Defective compressor.
- 9. Restrictive ducting.
- 10. Optional Condensate Pump Safety Switch open.

#### **Unit Test to determine problem:**

- 1. Detach field control wiring connections from main unit.
- 2. Connect the yellow and green pigtails from the main unit together; only the fan should run. Disconnect the wires.
- 3. Connect the yellow and blue pigtails from the main unit together; the compressor and fan should run.
- 4. If these tests work, the main unit is working properly. You should check the control panel and field control wiring for problems next.
- 5. Remove the control panel from the mounting box and detach it from the field installed control wiring. Connect the blue, yellow, and green wires from the control panel directly to the corresponding colored pigtails on the main unit. Leave the violet, white and red wires disconnected!
- 6. Turn on the fan switch; the fan should run. Turn off the fan switch.
- 7. Turn on the humidity control; the compressor and fan should run.
- 8. If these tests work, the problem is most likely in the field control wiring.

#### 10.3 Refrigerant Charging

If the refrigerant charge is lost due to service or a leak, a new charge must be accurately weighed in. If any of the old charge is left in the system, it must be recovered before weighing in the new charge. Refer to the unit nameplate for the correct charge weight and refrigerant type.



#### FOR HVAC INSTALLER ONLY

#### 10.4 Compressor/Capacitor Replacement

This compressor is equipped with a two terminal external overload and a run capacitor, but no start capacitor or relay.

# **A** CAUTION

CAUTION-ELECTRICAL SHOCK HAZARD: Electrical power must be present to perform some tests. These tests should be performed by a qualified service person.

#### **10.5 Electric Ventilation Damper**

The electric ventilation damper is controlled by the ventilation timer. The damper will open when the ventilation timer is activated to allow fresh air into the structure through the fresh air inlet duct. The electric ventilation damper will remain closed when the ventilation timer is not activated to prevent over-ventilating the structure when the unit is dehumidifying or recirculating the indoor air. The electric ventilation timer operates on 24 Vac from the control circuit. DO NOT connect high voltage to the damper motor or damage to the motor may result. DO NOT force the blade of the damper by hand or damage to the damper motor may result.

The damper opens in one direction only. The damper rotates very slowly, allow sufficient time for the damper to cycle. The damper will take approximately one minute to cycle from closed to open or from open to closed.

If the electric ventilation damper fails to operate:

- 1. Check that the wiring is correct and that voltage is present at the damper motor.
- 2. Check for any obstruction inside the damper. If the electric ventilation damper fails to operate after performing these checks, it must be replaced.



## **Quest DRY 70 Dehumidifier Limited Warranty**

#### **WARRANTOR:**

Therma-Stor LLC 4201 Lien Rd Madison, WI 53704

Telephone: 1-800-533-7533

**WHO IS COVERED:** This warranty extends only to the original residential end-user of the Quest *Dry* 70 dehumidifier, and may not be assigned or transferred.

**FIRST YEAR WARRANTY:** Therma-Stor LLC warrants that, for one (1) year after date of original purchase the Quest *Dry* 70 Dehumidifier will operate free from any defects in materials and workmanship. Therma-Stor LLC's exclusive obligation under this warranty will be to supply, without charge, a replacement for the dehumidifier which is found to be defective within a one (1) year period from date of purchase and which is returned not later than thirty (30) days after said one (1) year period to Therma-Stor LLC, Madison, WI together with proof of purchase of the dehumidifier.

**SECOND THROUGH FIFTH YEAR WARRANTY:** Therma-Stor LLC further warrants that for a period of five (5) years, the condenser, evaporator, and compressor of the Quest *Dry* 70 dehumidifier will operate free of any defects in material or workmanship, or Therma-Stor LLC, at its option, will repair or replace the defective part(s), provided that all labor and transportation charges for the part(s) shall be borne by the end-user.

**END-USER RESPONSIBILITIES:** If warranty service is to be performed on the Quest *Dry* 70, a technician authorized by Therma-Stor LLC must perform such service. If the End-user is unable to locate or obtain warranty service from an authorized technician, he should call Therma-Stor LLC at the above number and ask for the Service Department, which will then arrange for covered warranty service. Warranty service will be performed during normal working hours.

The End-user must present proof of purchase (lease) upon request, by use of the warranty card, receipt, invoice or other reasonable and reliable means. The end-user is responsible for normal care. This warranty only applies to residential applications, and is void if the Quest *Dry* 70 Dehumidifier is used in commercial and/or industrial applications including but not limited to water treatment facilities and industrial process applications. This warranty is void if the Quest *Dry* 70 is used in any swimming pool application. This warranty does not cover any defect, malfunction, etc. resulting from misuse, abuse, lack of normal care, corrosion, freezing, flooding, tampering, modification, unauthorized or improper repair or installation, accident, acts of nature or any other cause beyond Therma-Stor LLC's reasonable control.

**LIMITATIONS AND EXCLUSIONS:** If any Quest *Dry* 70 Dehumidifier part is repaired or replaced, the new part shall be warranted for only the remainder of the original warranty period applicable thereto (but all warranty periods will be extended by the period of time, if any, that the Quest *Dry* 70 Dehumidifier is out of service while awaiting covered warranty service).

UPON THE EXPIRATION OF THE WRITTEN WARRANTY APPLICABLE TO THE Quest Dry 70 DEHUMIDIFIER OR ANY PART THEREOF, ALL OTHER WARRANTIES IMPLIED BY LAW, INCLUDING MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, SHALL ALSO EXPIRE. ALL WARRANTIES MADE BY THERMA-STOR LLC ARE SET FORTH HEREIN, AND NO CLAIM MAY BE MADE AGAINST THERMA-STOR LLC BASED ON ANY ORAL WARRANTY. IN NO EVENT SHALL THERMA-STOR LLC, IN CONNECTION WITH THE SALE, INSTALLATION, USE, REPAIR OR REPLACEMENT OF ANY SANTA FE DEHUMIDIFIER OR PART THEREOF BE LIABLE UNDER ANY LEGAL THEORY FOR ANY SPECIAL, INDIRECT OR CONSEQUENTIAL DAMAGES INCLUDING WITHOUT LIMITATION WATER DAMAGE (THE END-USER SHOULD TAKE PRECAUTIONS AGAINST SAME), LOST PROFITS, DELAY, OR LOSS OF USE OR DAMAGE TO ANY REAL OR PERSONAL PROPERTY.

Some states do not allow limitations on how long an implied warranty lasts, and some do not allow the exclusion or limitation of incidental or consequential damages, so one or both of these limitation may not apply to you.

LEGAL RIGHTS: This warranty gives you specific legal rights, and you may also have other rights which vary from state to state.

